


-15kV TOF: -9116 v
 -3.6kV MCP: -2593 v
 -2.4kV MCP: -1589 v
 Input Cur: 330 ma
 RPA max: 237 v
 Mirror max: 238 v

Tue Feb 24 08:51:11 2004

TIDE Direct Events

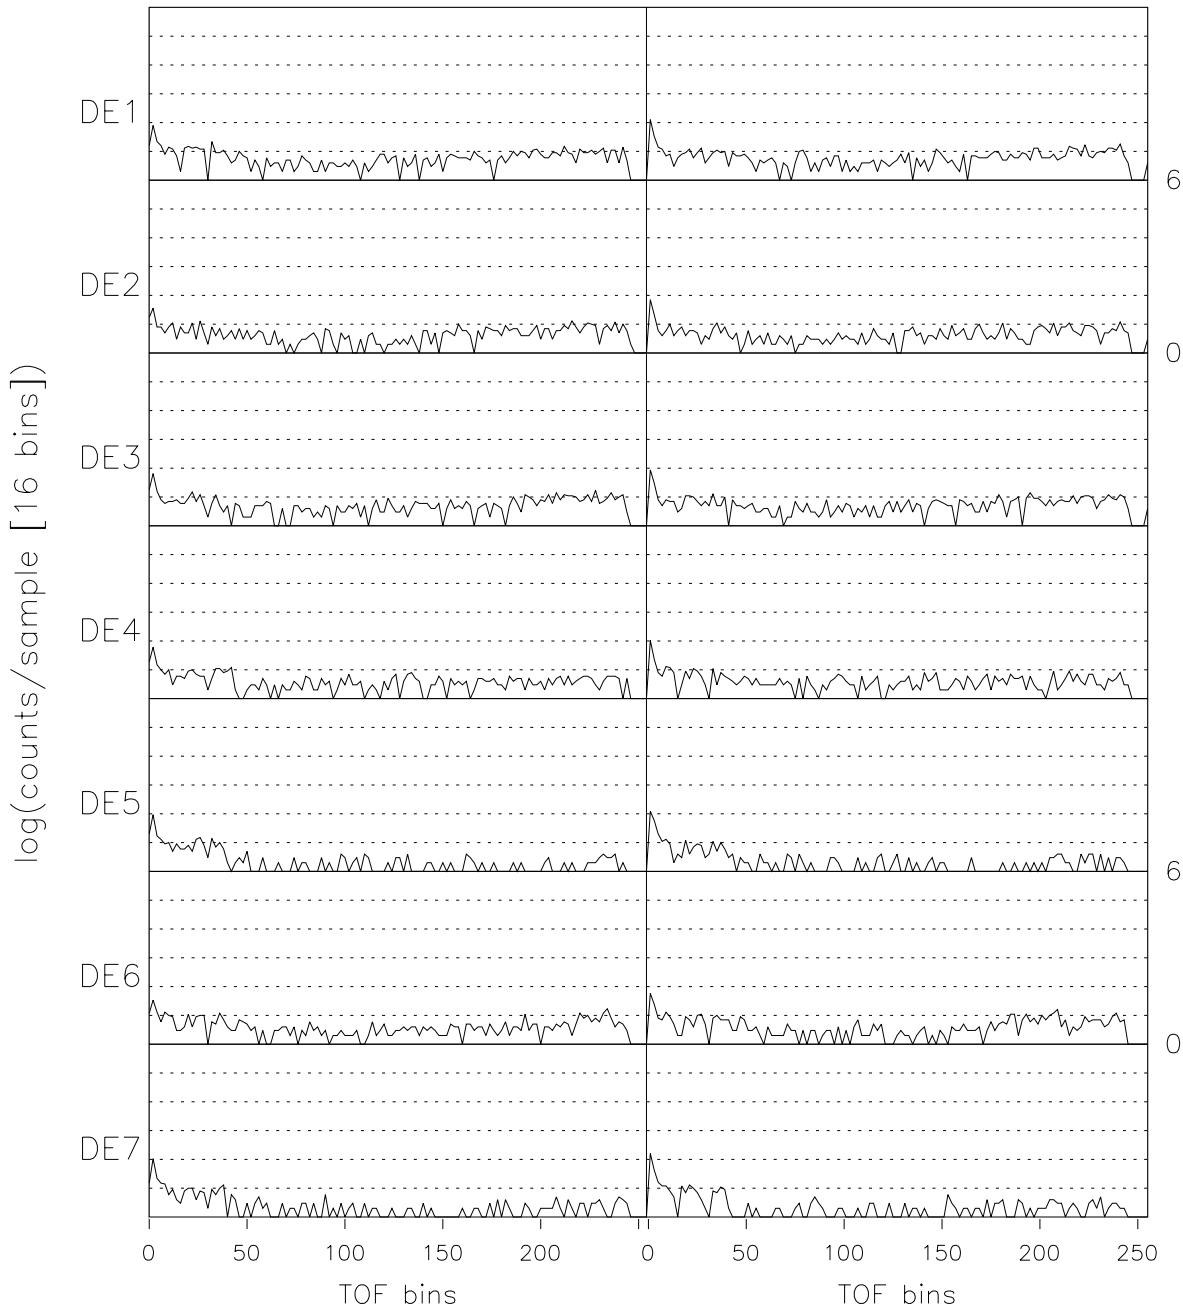

reported: 09-04-98 20:51:41 UT

reported: 09-04-98 20:54:53 UT

file: /export/data/tide/nrt/98090401.dat

-15kV TOF: -9181 v

-3.6kV MCP: -2578 v

-2.4kV MCP: -1579 v

Input Cur: 304 ma

RPA max: 237 v

Mirror max: 238 v